



PLAN VIEW

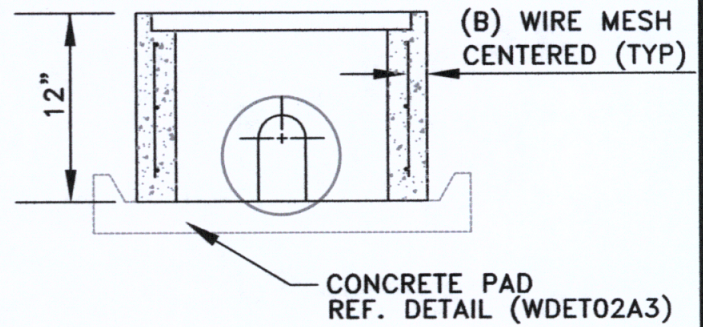


END VIEW

METER BOX TOP SECTION
SEE REF. DETAIL (WDET02A2)

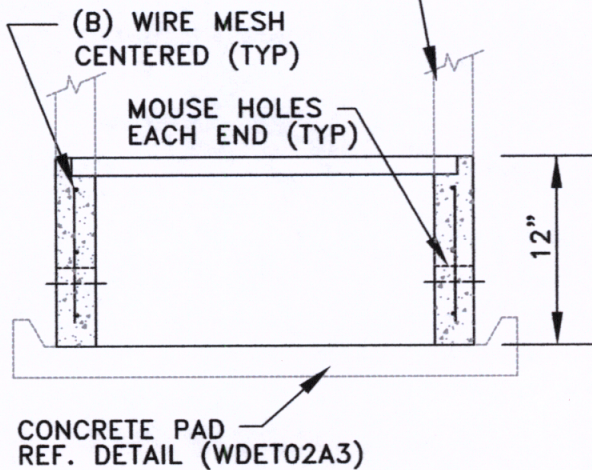

SIDE VIEW

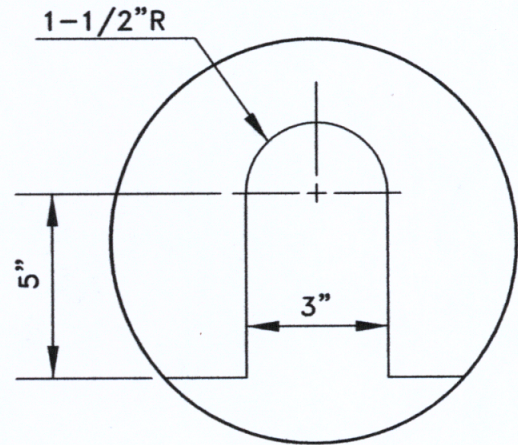

ENLARGED MOUSE HOLE

METER BOX BASE SECTION

NOTES:

- (A) 4500 PSI CONCRETE SHALL BE USED
- (B) ALL CONCRETE SIDEWALLS TO BE REINFORCED WITH 6x6x6 (6x6-W2.9xW2.9) WIRE MESH CENTERED.

CONCRETE METER BOX AND PAD MUST BE A PREAPPROVED DESIGN. BRICK CONSTRUCTION MAY BE USED WITH PREAPPROVAL FROM METRO WATER SERVICES.

METRO WATER SERVICES

METER BOX BASE SECTION

NOT TO SCALE DATE: 11/08/13

DWG. NO. WDET02A1



Hal Balthus
LICENSED DISTRIBUTION SYSTEM OPERATOR

JR#
DIRECTOR OF WATER AND SEWERAGE SERVICES