




PRIMARY LOCATION: MXU TO BE INSTALLED  
IN MODIFIED CASTING COVER AS PER  
METRO WATER SERVICES PERMIT OFFICE.  
1-3/4" DIAM. HOLE IN CENTER OF 4-1/4"  
DIAM. SMOOTH AREA.

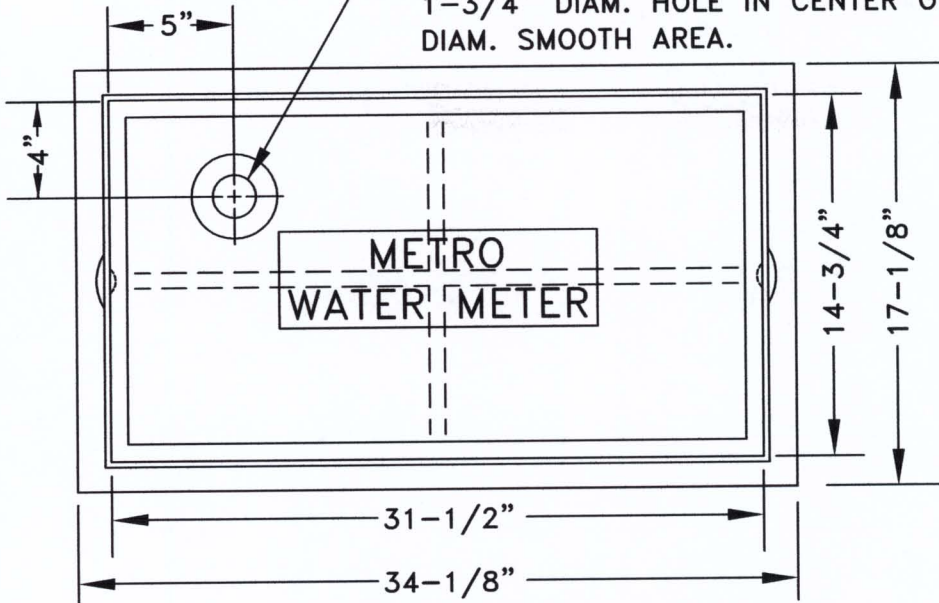


TOP VIEW

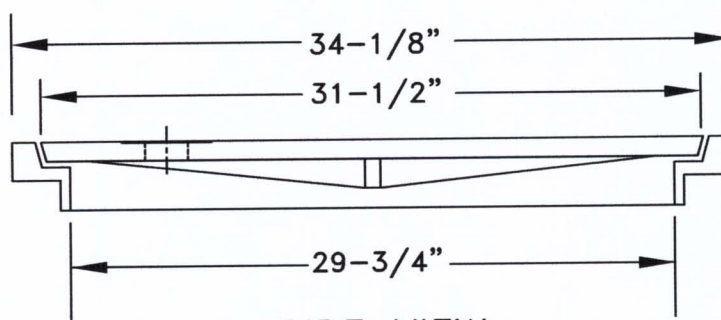

SIDE VIEW

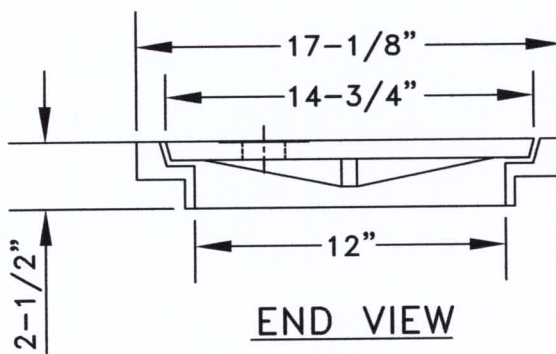

END VIEW

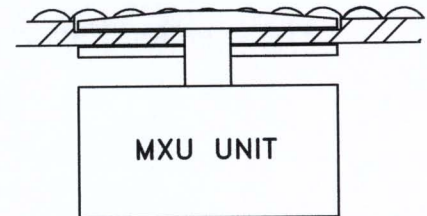

MXU MOUNTING

RADIO READ UNIT (MXU) TO BE  
INSTALLED ON SERVICE LINES AS  
INDICATED BY METRO WATER  
SERVICE PERMIT OFFICE.

JBS FRAME & COVER 8110  
OR APPROVED EQUAL.

**METRO WATER SERVICES**

**LARGE STANDARD NON-TRAFFIC  
METER BOX FRAME AND COVER**

NOT TO SCALE | DATE: 02/22/08

DWG. NO. WDET015C

**METRO**  
WATER SERVICES

*Hal Baltheop*  
LICENSED DISTRIBUTION OPERATOR

*[Signature]*  
DIRECTOR OF WATER AND SEWERAGE SERVICES