

* VARIANCE REQUIRED FOR THIS ARRANGEMENT.

NO TEES OR CONNECTIONS
BETWEEN METER BOX AND
TEE INSIDE BUILDING


NOTES:

ALL DOMESTIC AND IRRIGATION METERS SHALL BE LOCATED IN R.O.W., EXCLUDING SIDEWALKS, UNLESS APPROVED BY MWS.

PRIVATE INFRASTRUCTURE LOCATED WITHIN THE R.O.W. WILL REQUIRE AN ENCROACHMENT AGREEMENT WITH METRO PUBLIC WORKS.

BUTTERFLY VALVES MAY BE USED ON DDCVA ONLY WHEN LOCATED INSIDE OF BUILDING.

FLUSHING VALVE WILL BE REQUIRED WHEN DISTANCE BETWEEN BACKFLOW AND WATER MAIN/SERVICE CONNECTION IS GREATER THAN 20 FEET.

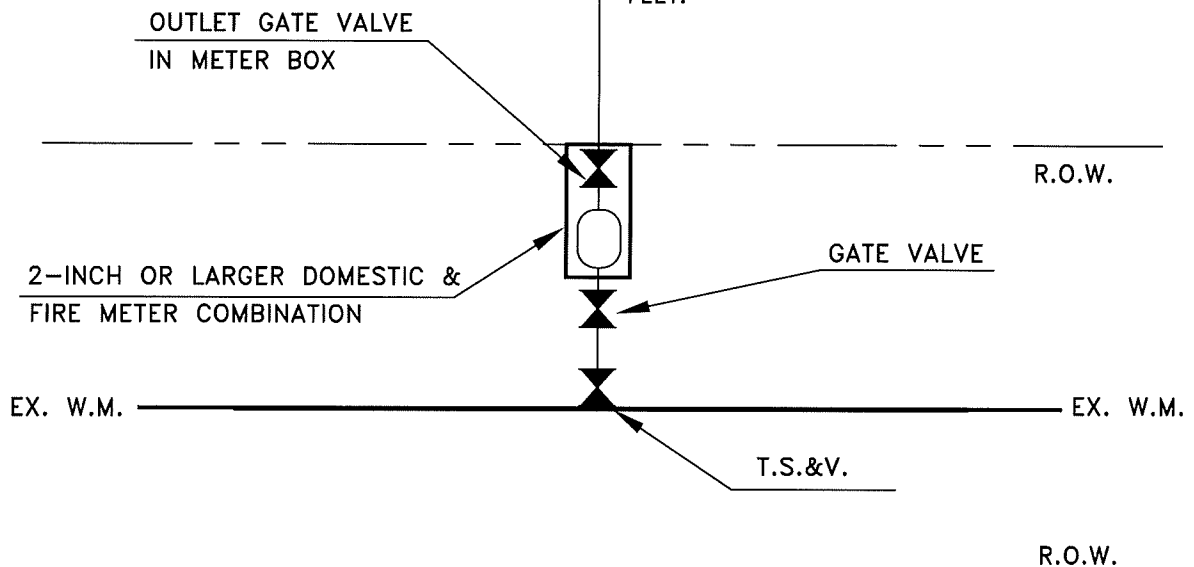

WATER LINE MUST BE PRESSURE CLASS 350 DIP RESTRAINT JOINT, COPPER, OR APPROVED EQUAL.

WATER LINE SHALL BE TESTED AND SAMPLED ACCORDING TO MWS DISINFECTION SPECIFICATIONS.

TAPS TO BE MADE 24 INCHES FROM BELL.

METRO WATER SERVICES

**2-INCH OR LARGER COMBINATION
DOMESTIC & FIRE SERVICES**

NOT TO SCALE | DATE: 4/19/18

DWG. NO. SHEMATIC 4



Deane B. Scott

LICENSED DISTRIBUTION OPERATOR

ST

DIRECTOR OF WATER AND SEWERAGE SERVICES