


NOTE:  
 PROVIDE NO ANCHOR ON GRADES LESS THAN 20% UNLESS NOTED. PROVIDE ANCHOR 36' C.-C. ON GRADES BETWEEN 20% AND 34% FOR CONDITIONS OTHER THAN SHOWN HEREON PROVIDE ANCHORS AS REQUIRED BY THE CONTRACT OR ORDERED BY THE ENGINEER IN THE FIELD. CONCRETE SHALL BE PAID FOR UNDER CONTRACT ITEM FOR CONCRETE AND/OR ENCASEMENT.

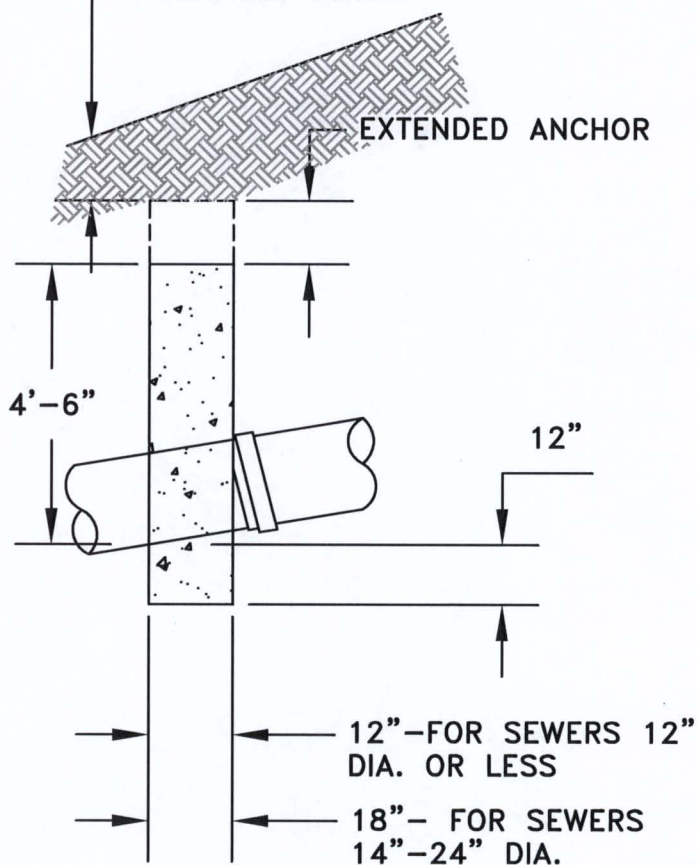

METRO WATER SERVICES

CONCRETE ANCHOR DETAILS

NOT TO SCALE DATE: 02/22/08

DWG. NO. SDET009



*Hal Battling*  
 LICENSED COLLECTION OPERATOR

*S. With*  
 DIRECTOR OF WATER AND SEWERAGE SERVICES