



TOP VIEW OF LOCKING BAR

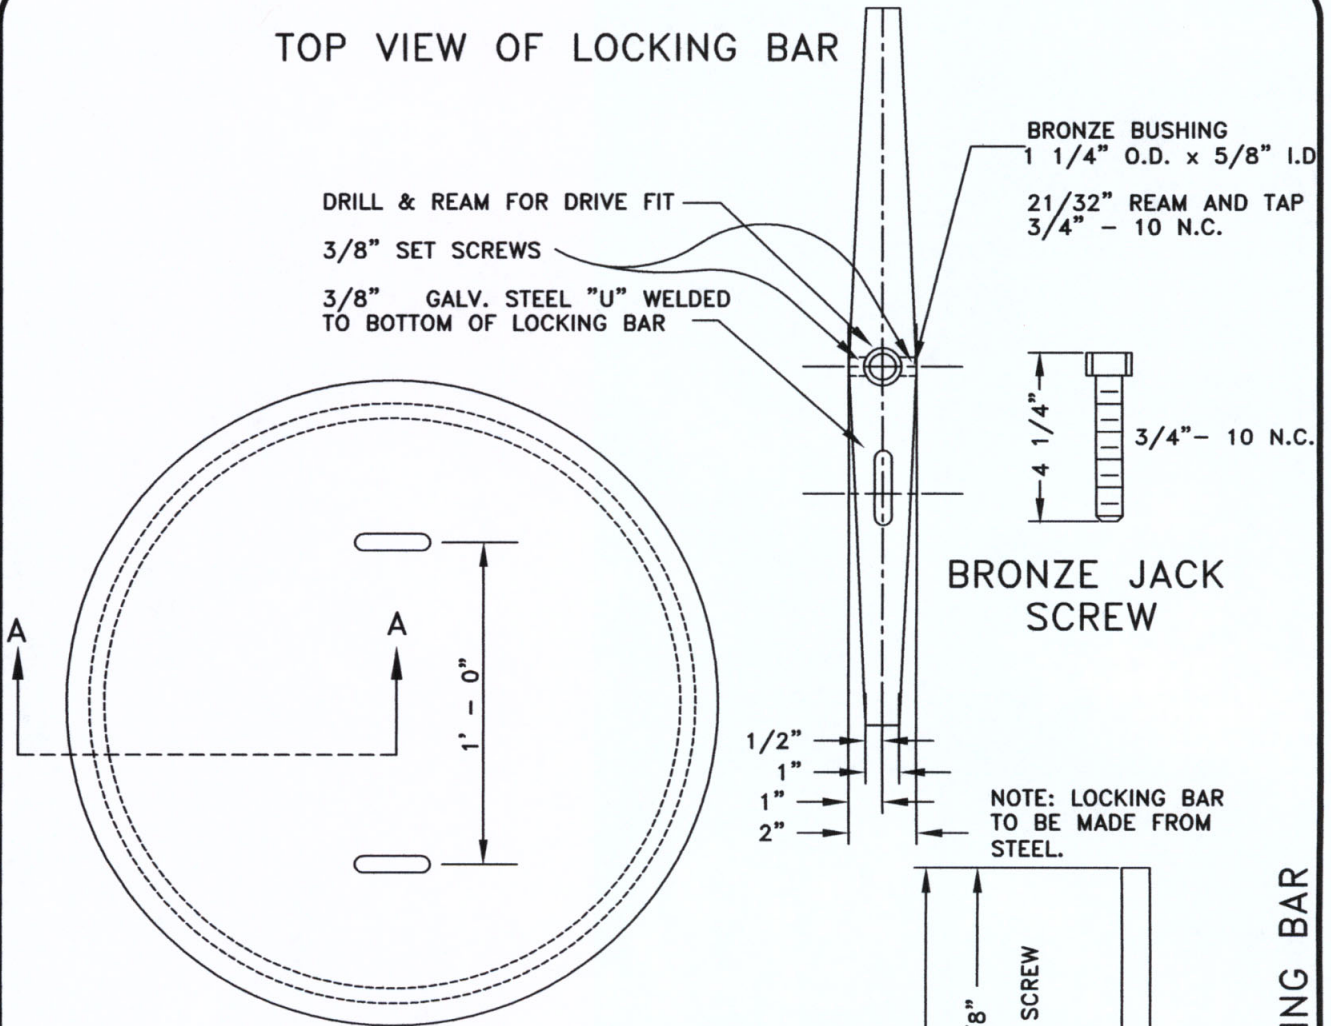

TOP VIEW


GALVANIZED EYE BOLT
1/2" x 8" x 1 1/4" I.D.
2 EACH REQ.

RUBBER GASKET 19 1/4" I.D. x
21" O.D. x 1/8" THICK.
1 EACH REQ.

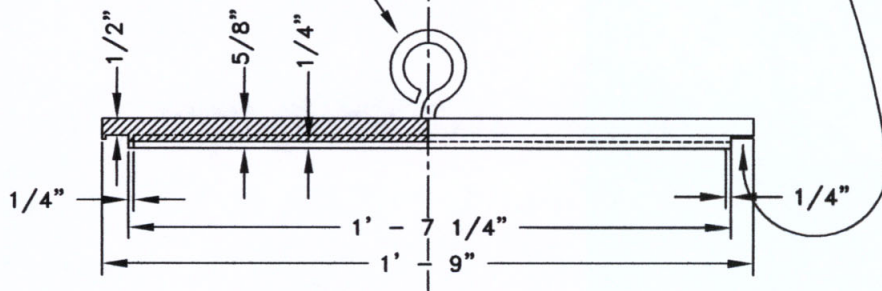

SECTION A-A

NOTE: CONTACT SURFACE OF COVER
MARKED "f" ARE TO BE MACHINED

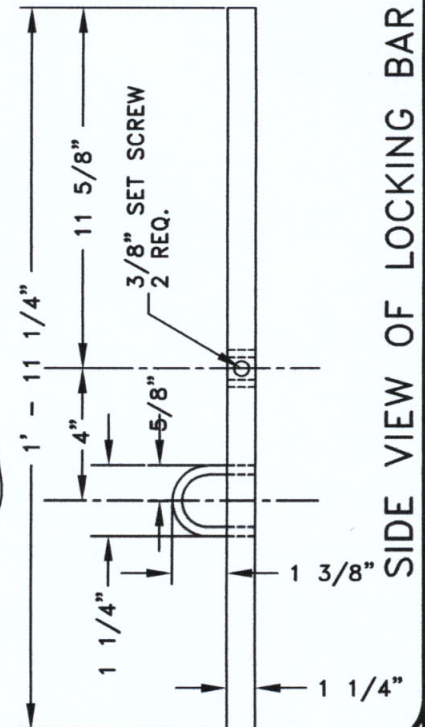

METRO WATER SERVICES

WATER SEALING COVER &
LOCKING BAR FOR NO. 12

NOT TO SCALE DATE: 05/05/08

DWG. NO. SDET019

METRO
WATER SERVICES

Hal Balthrop
LICENSED COLLECTION OPERATOR

S. R. Rott

DIRECTOR OF WATER AND SEWERAGE SERVICES