


GENERAL NOTES:

- ALL FITTINGS AND LINES TO BE PVC, SOLVENT WELD (SDR-35)
- DEVICE SHOULD BE INSTALLED AFTER FINAL GRADE HAS BEEN PERFORMED.

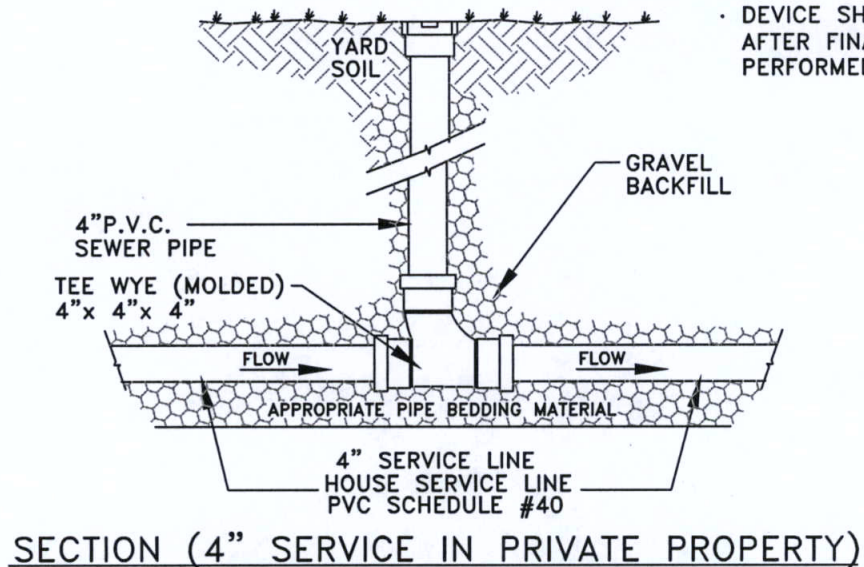

METRO WATER SERVICES

SEWER SERVICE LINE
STANDARD CLEAN OUT

NOT TO SCALE | DATE: 05/26/10

DWG. NO. SDET017A



Hal Balthez
LICENSED COLLECTION OPERATOR

Witt

DIRECTOR OF WATER AND SEWERAGE SERVICES