


ELEVATION

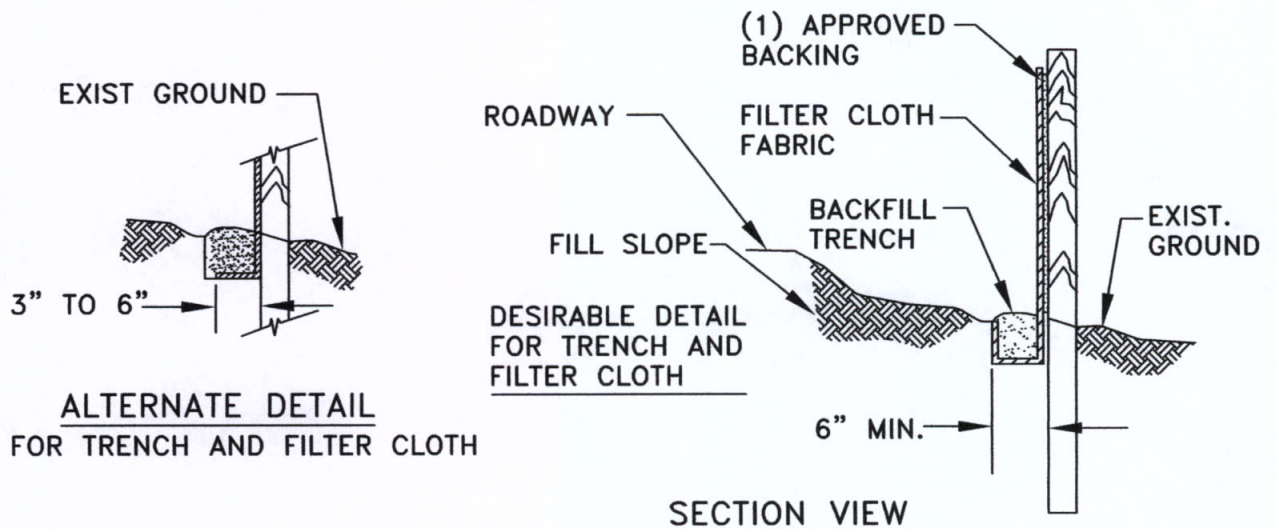

SECTION VIEW

NOTES:

- 1) BUILT-IN REINFORCED STRUCTURE, AS RECOMMENDED BY THE MANUFACTURER TO SUPPORT THE FILTER CLOTH.
- 2) FILTER CLOTH SHALL MEET THE REQUIREMENTS OF SECTION 209 OF STANDARD SPECIFICATIONS. (TDOT)
- 3) A PRE ASSEMBLED SILT FENCE MEETING THE REQUIREMENT OF THIS DRAWING IS ACCEPTABLE IN LIEU OF A FIELD CONSTRUCTED SILT FENCE.
- 4) ANY EROSION CONTROL MUST BE IN COMPLIANCE WITH MWS LATEST SPECIFICATIONS.

METRO WATER SERVICES

TYPICAL
TEMPORARY SILT FENCE

NOT TO SCALE | DATE: 05/05/08

DWG. NO. SDET012



Hal Batthys
LICENSED COLLECTION OPERATOR

Smith
DIRECTOR OF WATER AND SEWERAGE SERVICES